MINIMUM DISTANCE
10'-0" FROM
POSSIBLE IGNITION SOURCE
VENT OPENING TO BE
POSITIONED DOWNWARD c/w
BUG SCREEN

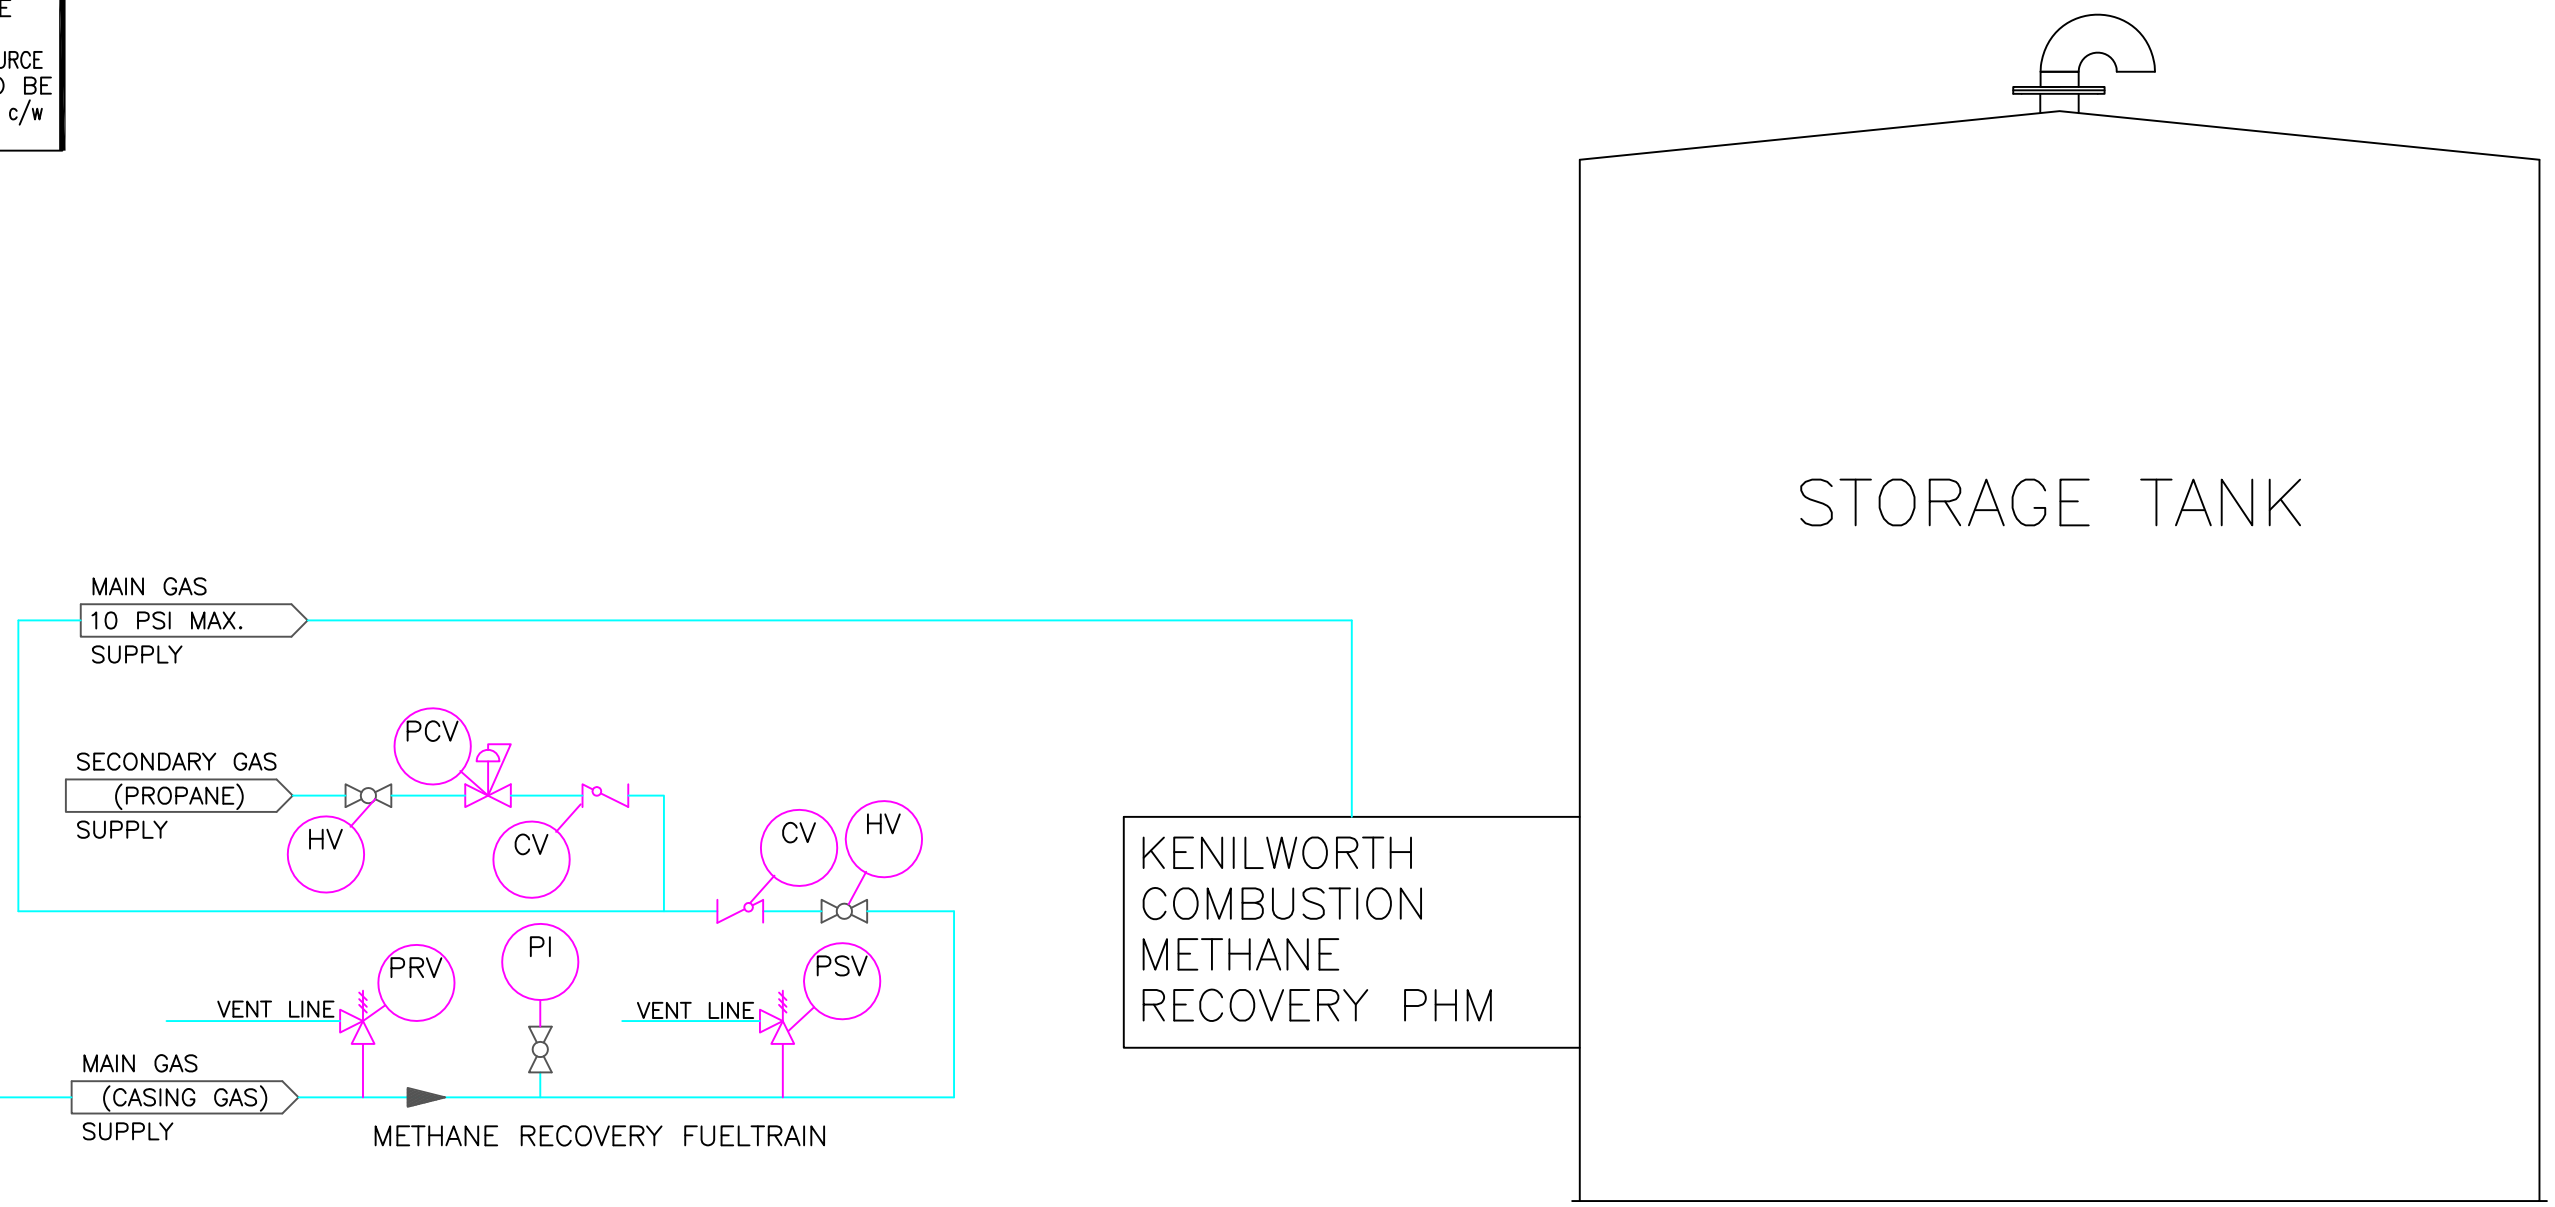

NOTES:

1.1 PRESSURE TEST TO 15 PSI FOR 1 HOUR IN ACCORDANCE WITH CSA B149.1-15 CLAUSE 6.22.1, 6.22.2, AND TABLE 6.3.
1.2 PRESSURE TESTED TO NORMAL MAXIMUM OPERATING PRESSURE FOR 60 MINUTES IN ACCORDANCE WITH CSA B 149.1-15 CLAUSE 6.22.3.
2.0 ALL PIPING SHALL BE SCHED 80 OR HEAVIER, ALL FORGED FITTINGS TO HAVE MAWP OF 2000 PSIG OR GREATER.

LEGEND

---- FIELD WIRE
——— SHOP WIRE

METHANE RECOVERY: SITE CONCEPTUAL

REFERENCE DRAWINGS	DWG. NO.
ELECTRICAL DIAGRAM	UI_2016_JP_MR_SS_PF_24_ELEC

NO.	DATE	PROJECT DESCRIPTION	EWR No.	EPCM Co.	EPCM No.	ENG.
0		ISSUED FOR CONSTRUCTION	·			
·	–	·	·			
·	–	·	·	·	·	·
·	–	·	·	·	·	·
·	–	·	·	·	·	·
·	–	·	·	·	·	·
·	–	·	·	·	·	·
·	–	·	·	·	·	·

REV.NUMBER 0	ISSUE STAGE	DATE	BY	CHKD.	APPD.
	Prelim.	–	·	·	·
	Approval	–	·	·	·
	Tender	–	·	·	·
	Const.			·	·
	As-built	–	·	·	·
	·	–	·	·	·
	·	–	·	·	·
	·	–	·	·	·

Kenilworth Combustion

EPCM.CO

EPCM.NO

LSD –

DATE MAY 09/2016

SCALE NTS (A3 Size)

TITLE UNDER 1MM BTU/hr SWEET SERVICE B149.3-15 COMPLIANT BURNER PIPING & INSTRUMENTATION DIAGRAM

AREA STANDARD

FILE NO. METHANE RECOVERY SITE CONCEPTUAL